

What's In My Water?

We are pleased to report that during the past year, the water delivered to your home or business complied with, or did better than, all state and federal drinking water requirements. Each year we analyze over 50,000 water samples for bacteria, turbidity, inorganic contaminants, lead and copper, nitrate, volatile organic contaminants, total trihalomethanes, and synthetic inorganic contaminants. For your information, we have compiled a list in the table below showing what substances were detected in our drinking water. Although all of the substances listed below are under the Maximum Contaminant Level (MCL) set by U.S. EPA, we feel it is important that you know exactly what was detected and how much of the substance was present in the water. None of the other substances regulated by EPA were detected in our water.

Alpena's water use during the year 2001:

- 777.95 million gallons, yearly total.
- 2.3 million gallons, average day.
- 3.99 million gallons, maximum day.

REGULATED SUBSTANCES

SUBSTANCE (UNITS)	YEAR SAMPLED	MCL	MCLG	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Barium (ppm)	2001	2	2	0.01	NA	No	Discharge of drilling wastes; Discharge from metal refineries Erosion of natural deposits.
Selenium (ppm)	2001	.05	.05	.001	NA	No	Erosion of natural deposits.
Fluoride (ppm)	2001	4	4	1.1	NA	No	Erosion of natural deposits, Water additive which promotes strong teeth, discharge from fertilizer & aluminum factories.
TTHMs (ppb)	2001	80	0	31.4	20.1-48.2	No	By-product of drinking water chlorination.
Turbidity (NTU)	2001	TT	NA	0.14	.04-0.14	No	Soil runoff.
Alpha Emitters (pCi/l)	1998	15	0	1.0	NA	No	Erosion of natural deposits.

TABLE DEFINITIONS

MCL - Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCL's are set as close to the MCLG's as feasible using the best available treatment technology.

MCLG - Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLG's allow for a margin of safety.

ppm-Parts per million: One part per million (or milligrams per liter) is equivalent to one penny in \$10,000.

ppb-Parts per billion: One part per billion (or micrograms per liter) is equivalent to one penny in \$10,000,000.

NTU - Nephelometric Turbidity Units: Measurement of the clarity, or turbidity, of water.

TT-Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water.

AL - Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

NA - Not Applicable.

Pci/L - Picocuries per Liter: A measure of

UNREGULATED SUBSTANCES

SUBSTANCE (UNITS)	YEAR SAMPLED	MCL	MCLG	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Sodium (ppm)	2001	NA	NA	7	NA	No	Erosion of natural deposits.
Sulfate (ppm)	2001	NA	NA	34	NA	No	Erosion of natural deposits.
Haloacetic Acid (ppm)	1999	NA	NA	0.014	0.003-0.014	No	By-product of drinking water chlorination.
Chlorform (ppb)	2001	NA	NA	25	15.5-40.1	No	By-product of drinking water chlorination.
Dibromochloro- methane (ppb)	2001	NA	NA	5.4	3.9-6.9	No	By-product of drinking water chlorination.
Bromodichloro- methane	2001	NA	NA	0.9	0.7-1.2	No	By-product of drinking water chlorination.

DISTRIBUTION SYSTEM SUBSTANCES: Lead and copper samples were collected from taps at 30 high-risk homes. These levels found are not found in the City's water and demonstrate levels found in the plumbing of the household.

SUBSTANCE (UNITS)	YEAR SAMPLED	ACTION LEVEL	MCLG	AMOUNT DETECTED	SITES ABOVE AL	VIOLATION	TYPICAL SOURCE
Copper (ppm)	1999	1.3	1.3	0.287	0	No	Corrosion of household plumbing.
Lead (ppb)	1999	15	0	4	0	No	Corrosion of household plumbing.



Shift operator, Dale Goupell

Substances Expected to be in Drinking Water

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S.EPA's Safe Drinking Water Hotline (1-800-426-4791).

Substances that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses;

Inorganic Contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems;

Radioactive Contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

Drinking Water and People with Weakened Immune Systems

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791)

DRINKING WATER IMPROVEMENT PROJECTS

In order to provide exceptional service to our customers, we must maintain our existing facilities, and upgrade them when necessary, which we consider a continually ongoing process.

One of the more significant projects completed during the year:

A computer data gathering system was installed on the nine filter discharge and clear well influent points. This system monitors water quality from the finished water side of our filters and will alarm and notify the on-duty operator if quality is not being met.



Computer screen continually displays information about all nine points which in turn monitor finished water quality. From this screen all other program screens are available.

Data gathering processor is located in the lowest point in the plant. This unit is one of two sending collected information to the monitoring computer.

Turbidity measuring unit. Unit is located in the lowest point in the plant and by having the unit down low water flow is increased thereby the information gains accuracy.



Shift operator, Jason Patzer

What it takes to be a water plant operator.

Operating a water plant requires a variety of talents from electronics to hands on mechanical skills to computer skills and water lab skills. All of these are required to operate one eight hour shift. To maintain this level of talent and maintain a water license in the State of Michigan, continuing education credits must be obtained. Each operator will attend a mixture of classes throughout the year.

INFORMATION ON THE INTERNET

Water quality reports going back to 1998 can be found on the City of Alpena web site (www.alpena.mi.us). In addition, the EPA Office of Water (www.epa.gov/watrhme) has a web site provides a substantial amount of information on many issues relating to water resources, water conservation and public health.

I hope you enjoyed reading this water quality report, *enjoy the summer. Jplume*



Shift operator, Terry Gougeon

Where does our water come from?

Our fresh water source is **surface water from Thunder Bay (Lake Huron)**. This source has been utilized in Alpena since 1905, and sample data shows that it is of high quality. Over the last 25 years, state and federal environmental regulations have become progressively more stringent resulting in significant improvements in Great Lakes water quality. Efforts to protect our fresh water source include a formal "Source Water Assessment" conducted by the Michigan Department of Environmental Quality. The assessment identifies sources of pollution that may have a negative impact on the quality of our source water. The assessment is in the preliminary stage and copies are available upon request. Customer comment on the information found in the assessment is welcome. Contact your water production plant for information of how to receive your copy (356-0757).




Water Conservation Tips

Water conservation measures are an important first step in protecting our water supply. Such measures not only save you money by reducing your water, but can also save you money by reducing your water and sewer bills. Here are a few suggestions:

Conservation measures you can use inside your home include:

- Fix leaking faucets, pipes, toilets, etc.
- Install water-saving devices in faucets, toilets and appliances.
- Replace old fixtures (could reduce water consumption by nearly one-half!).
- Wash only full loads of laundry.
- Do not use the toilet for a trash disposal.
- Take shorter showers.
- Do not let the water run while shaving, washing, brushing teeth, or cleaning fruits and vegetables.
- Soak dishes before washing.
- Run the dishwasher only when full.
- Water the lawn and garden in the early morning or evening.

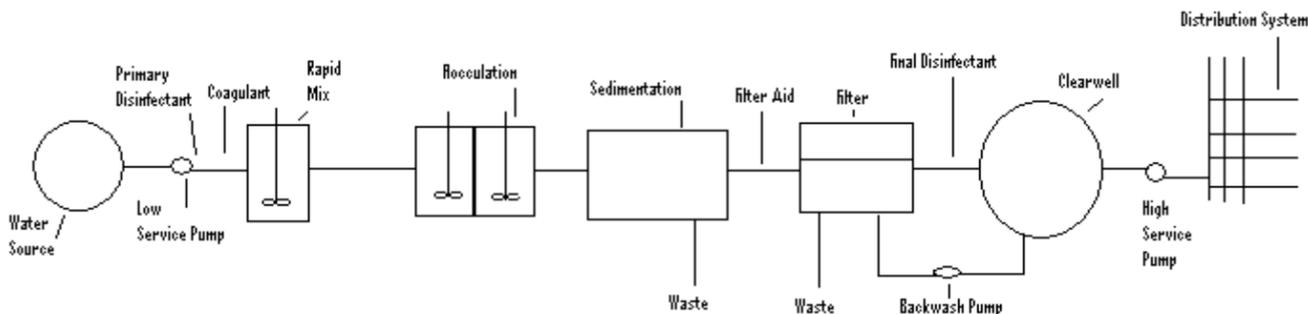

HOW IS MY WATER TREATED AND PURIFIED?

The treatment process consists of a series of steps. First, raw water is drawn from Thunder Bay (Lake Huron) and pumped directly to a mixing tank where chlorine, alum and polymer are added. The addition of these chemicals causes small particles to adhere to one another making them heavy enough to settle into a basin from which sediment is removed. After settling, filter aid is added, if necessary, for turbidity removal (turbidity is a common measure of the clarity of water). Also added at this point are fluoride (helps prevent tooth decay) and phosphate (helps prevent corrosion in water system). The water is then filtered through layers of fine carbon and silicate sand. As smaller, suspended particles are removed, turbidity disappears and clear water emerges. Chlorine is added again at this point as a precaution against any bacteria that may still be present. (We carefully monitor the amount of chlorine, adding the lowest quantity necessary to protect the safety of your water without comprising taste). The water is then pumped to sanitized reservoirs and water towers, and into your home or business.



Gavin & Jared Plume's favorite drink, Alpena's Water!

ANNUAL WATER QUALITY REPORT

ALPENA WATER TREATMENT PLANT
1300 STATE AVE.
ALPENA, MICH. 49707

Working Hard for You!

Under the Safe Drinking Water Act (SDWA), the United States Environmental Agency (EPA) is responsible for setting national limits for hundreds of substances in drinking water and also specifies various treatments that water systems must use to remove these substances. Similarly, the United States Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Each system continually monitors for these substances and reports directly to their state regulatory agency, which in turn reports to the EPA, if any are detected in the drinking water. EPA uses this data to ensure that consumers are receiving clean water and verify that states are enforcing the laws that regulate drinking water.

Our Water Quality Report conforms to the federal regulation under the SDWA requiring water utilities to provide detailed water quality information to each of their customers annually. We are committed to providing you with this information about your water supply, because customers who are well informed are our best allies in supporting improvements necessary to maintain our ability to provide the highest quality drinking water.

Customers are invited to contact our utility at any time with questions or concerns. Individual and group tours of our Water Treatment Plant can be arranged by calling (989) 356-0757. Also, please join us at our annual Open Hours during National Drinking Water Week in early May.

Our water utility customers should consider themselves to be investor-owners of the system. The utility is managed as an enterprise fund and all operation, maintenance, and replacement expenditures are financed entirely by user fees. Consequently, all customer inquiries, requests, or suggestions are welcome and encouraged by the utility. **The Alpena Municipal Council is responsible for overseeing the Alpena Water Utility. The City Council meets on the first and third Monday of every month.** Utility correspondence may be directed to the following personnel:

Mike Glowinski Utility Manager Earth Tech phone: 354-4891	Jerry Plume Plant Manager Earth Tech phone: 356-0757	Alan L. Bakalarski City Manager City of Alpena phone: 354-4158
--	---	---

E-mail Addresses:

Alan L. Bakalarski, City Manager	— alb@alpena.mi.us
Rich Sullenger, City Engineer	— richs@alpena.mi.us
Mike Glowinski, Utility Manager	— mglowinski@earthtech.com
Jerry Plume, Plant Manager	— jerry_plume@earthtech.com

QUESTIONS

Call U.S. EPA's Safe Drinking Water Hotline at 1-800-426-4791

We are pleased to provide you with our fourth Annual Water Quality Report. Included are details about where your water comes from, what it contains, and how it compares to Environmental Protection Agency (EPA) and state standards. The utility welcomes this annual reporting requirement and views it as an opportunity to inform our customers about the high quality drinking water being supplied to them. Alpena's water meets, or is better than, state and federal standards. We have had no violations of water quality standards during 2001.

If you have any questions about the contents of this report or have suggestions on making it more understandable, please contact Jerry Plume (Water Plant Superintendent) at 356-0757.